


London

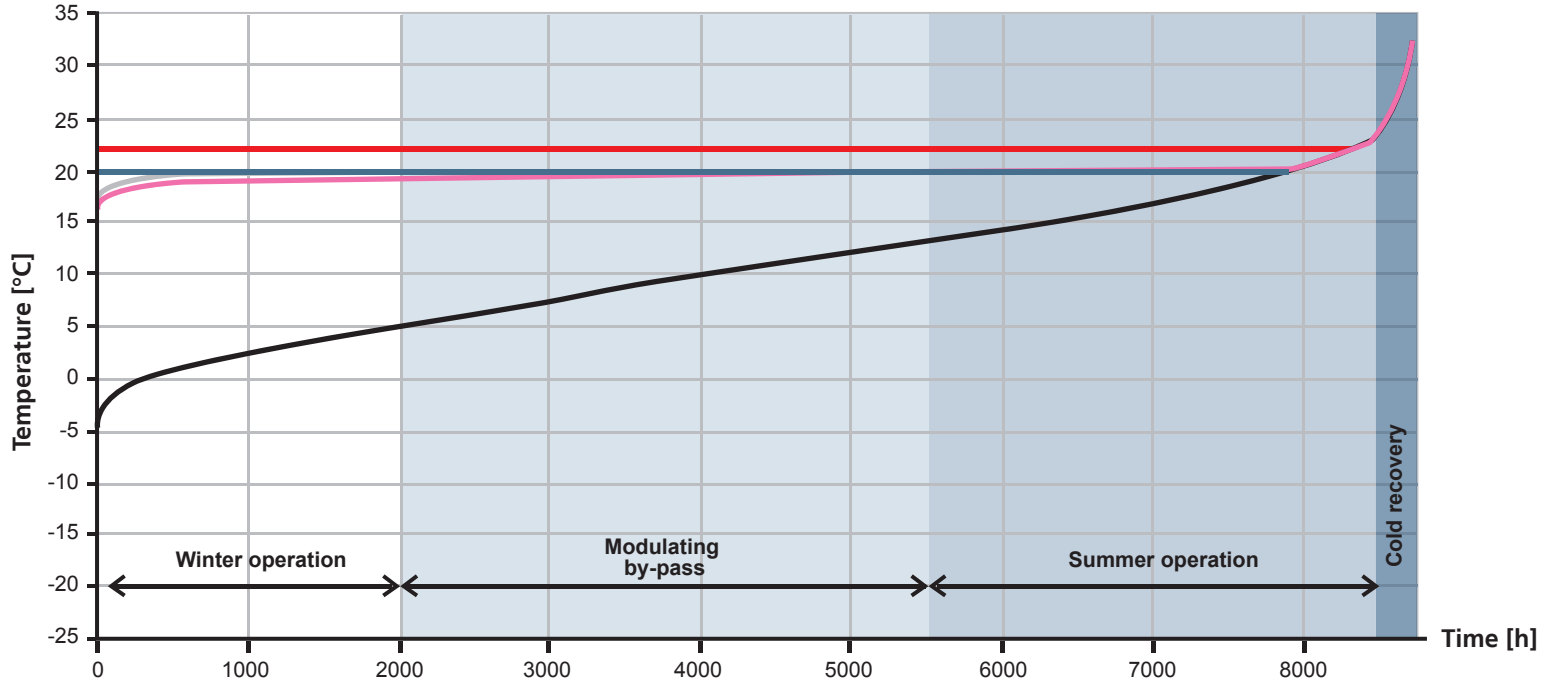

- Outdoor temperature
- Heat recovery temperature
- Extract air temperature
- Desired supply air temperature
- Supply air temperature with motor heating

□ SFP winter operation	2000 h/year @ 2000 J/m ³	} Yearly average SFP: 1734 J/m³
□ SFP modulating by-pass	3500 h/year @ 1750 J/m ³	
□ SFP summer operation	2900 h/year @ 1500 J/m ³	
■ SFP cold recovery	360 h/year @ 2000 J/m ³	
—————		
8760 h/year		